

SR_ ROOF PANEL CLIP W/
() ¼ - 14 x 2" TEK 3 W/O WASHER
PER CLIP, PER PANEL AT EACH LAP
SECONDARY SUPPORT


¼ - 14 x 7/8" STITCH
TEKS 2 ½" O/C AT LAP

NOTE: BUTYL SEALANT
AND BUTYL TAPE TO RUN
ACROSS FULL WIDTH OF
PANELS; NOT SHOWN AT
HIGH RIBS FOR CLARITY.

1" x 3/16" BUTYL TAPE SEALANT
FIELD-APPLIED 3/8" BEAD OF
NON-SKINNING BUTYL SEALANT AT
INTERIOR (LINER) SIDE CAVITY
FACTORY-APPLIED FOAM GASKET
AT UNDERSIDE OF SR ROOF CLIP

"JC-01" JOINT COVER
(SET TRIM IN BUTYL SEALANT)

SR ROOF PANEL ENDLAP (SECTION VIEW)

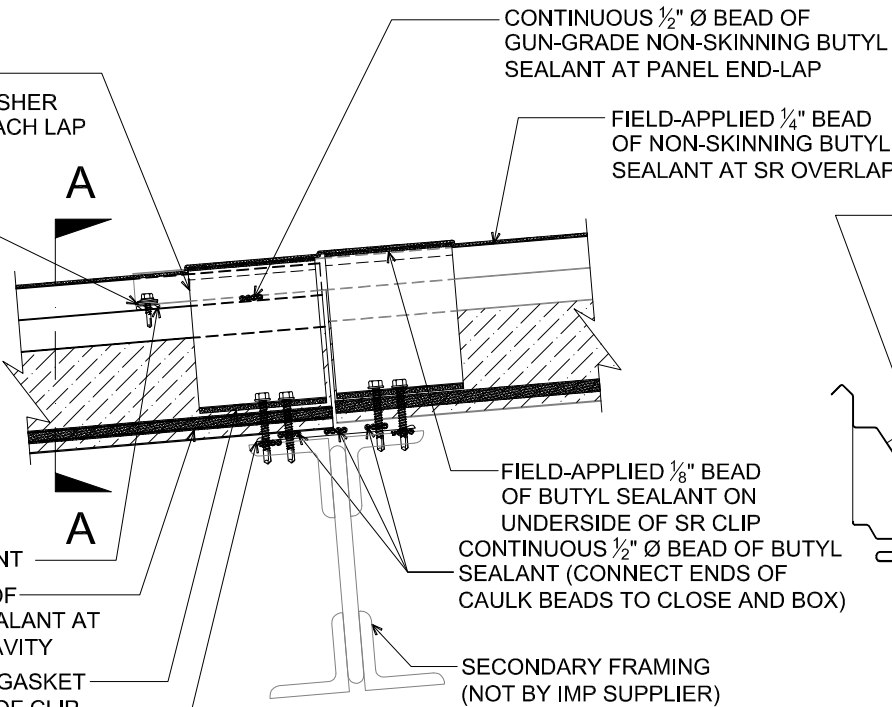


CONTINUOUS ½" Ø BEAD OF
GUN-GRADE NON-SKINNING BUTYL
SEALANT AT PANEL END-LAP

FIELD-APPLIED ¼" BEAD
OF NON-SKINNING BUTYL
SEALANT AT SR OVERLAP

FIELD-APPLIED ⅛" BEAD
OF BUTYL SEALANT ON
UNDERSIDE OF SR CLIP
CONTINUOUS ½" Ø BEAD OF BUTYL
SEALANT (CONNECT ENDS OF
CAULK BEADS TO CLOSE AND BOX)

SECONDARY FRAMING
(NOT BY IMP SUPPLIER)

NOTE: REFER TO SECTION 13.7 ON
THE SR2 INSULATED ROOF PANELS
GENERAL INSTALLATION GUIDE
FOR ADDITIONAL INFORMATION.

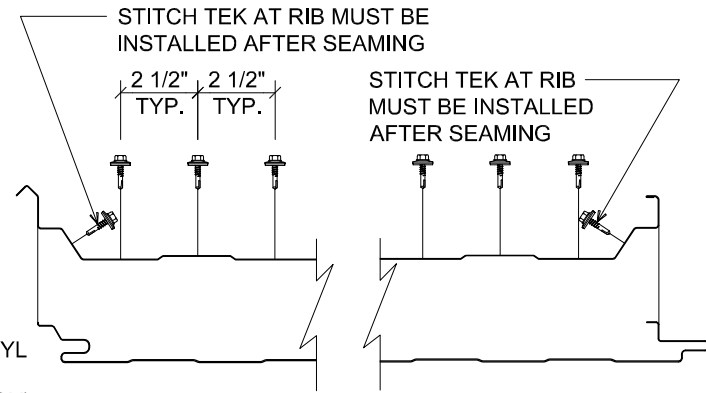

STITCH TEK AT RIB MUST BE
INSTALLED AFTER SEAMING

2 1/2" TYP. 2 1/2" TYP.

STITCH TEK AT RIB
MUST BE INSTALLED
AFTER SEAMING

SECTION A-A

NOTE: DO NOT OVER-DRIVE FASTENERS. IF THE METAL AT THE EDGE OF THE
PANEL IS DEFORMED OUT OF PLANE, THE ADJACENT PANEL WILL BE DIFFICULT TO
ENGAGE AND WILL NOT SEAM. AFTER SR CLIP HAS BEEN INSTALLED OVER MALE
LEG OF STANDING SEAM PANEL, PRE-CRIMP, USING ½" HAND CRIMPING TOOL.

DETAIL: ENDLAP

APPLICATION:
SR ROOF, COMMERCIAL & INDUSTRIAL, COLD-STORAGE, COLD-CLIMATE
AWIP DETAIL NUMBER:
SRR-CJCSCC-EL-002

929 ALDRIDGE ROAD
VACAVILLE, CA 95688
TEL: (707) 359-2280
FAX: (707) 359-2286
WWW.AWIPANELS.COM